



SECTION VIEW

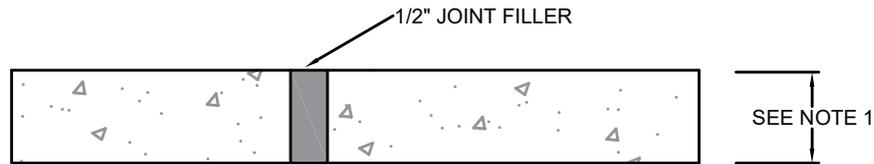

FILLED EXPANSION JOINT

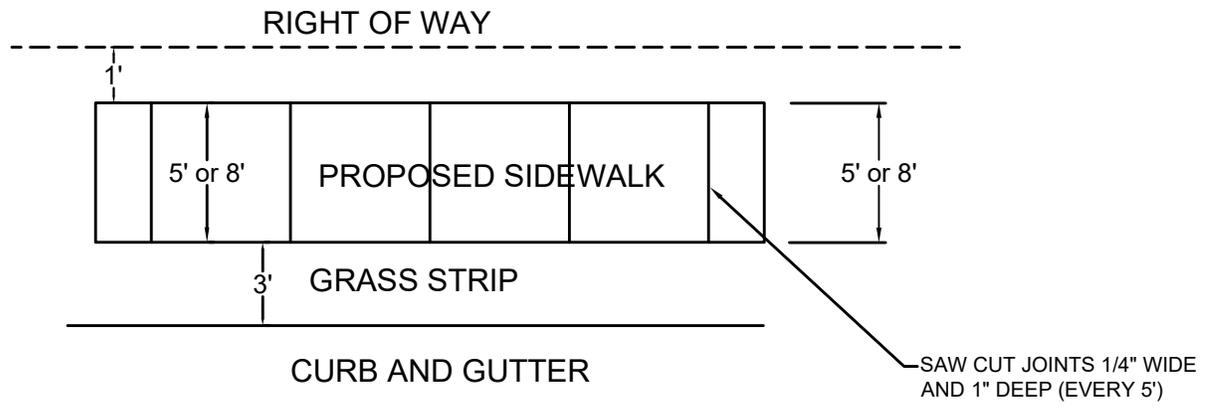

PLAN VIEW

NOTES:

1. SIDEWALK DEPTH SHALL BE 4" EXCEPT AT DRIVEWAYS WHERE THE DEPTH SHALL BE 6".
2. THE DISTANCE BETWEEN FILLED EXPANSION JOINTS SHALL BE 50' MAX.
3. ALL SIDEWALKS SHALL BE CONSTRUCTED WITH 3,000 PSI CONCRETE.
4. ALL MANHOLES, WATER VALVES AND METER BOXES MUST BE LOCATED OUTSIDE OF THE SIDEWALK AREA.
5. ALL SIDEWALK REPAIRS SHOULD BE FROM CONTRACTION JOINT TO CONTRACTION JOINT.
6. THE SIDEWALK WIDTH SHALL BE DETERMINED BY TOWN STAFF.

SECTION: STREETS	5' AND 8' WIDE CONCRETE SIDEWALK	PUBLIC SERVICES DEPARTMENT
DATE: 2021		
DRAWN BY: JWP		
CHECKED BY: TOWN PSD		
SCALE: NOT TO SCALE		