



D = PIPE INSIDE DIAMETER

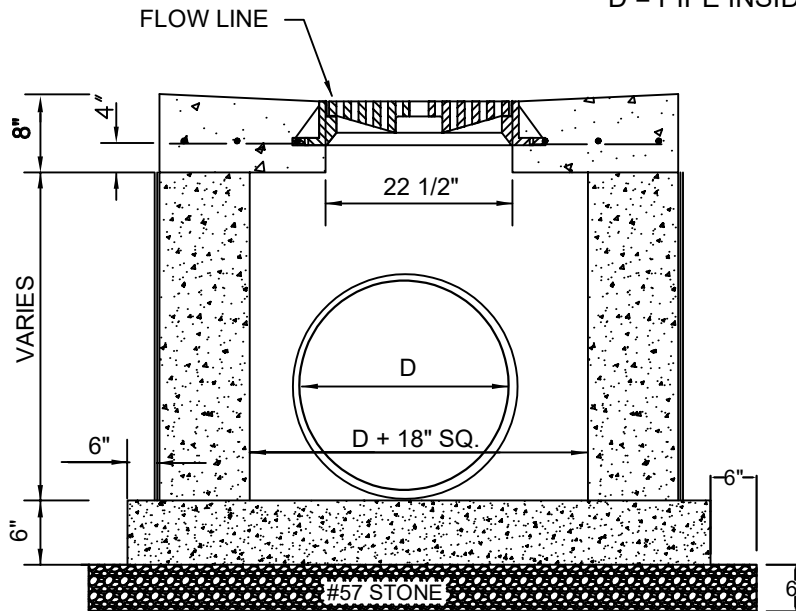

**NOTES:**

1. USE 4,000 PSI CONCRETE AND PROVIDE FOR HS-20 LOADING.
2. PROVIDE LIFT HOLES OR PIN IN ACCORDANCE WITH OSHA STANDARDS.
3. SEAL JOINTS WITH FLEXIBLE BUTYL RUBBER BASE CONFORMING TO ASTM M-19B.

|                      |   |   |
|----------------------|---|---|
| SECTION: STREETS     | PRECAST CONCRETE DROP<br>INLET BOX WITHOUT<br>KNOCKOUT PANELS | PUBLIC SERVICES<br>DEPARTMENT   |
| DATE: 2023           |   |  |
| DRAWN BY: JWP        |   |   |
| CHECKED BY: TOWN PSD |   |   |
| SCALE: NOT TO SCALE  |   |   |